


Greene County Engineer's Standards

Typical Road Section

"Residential or Local"

NOT TO SCALE

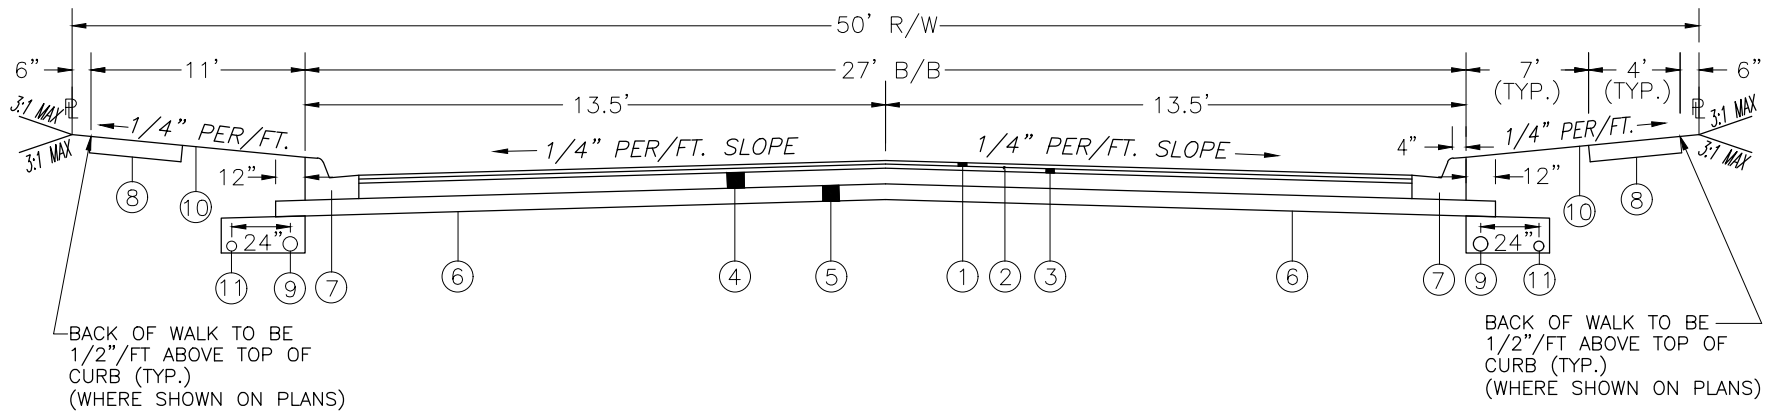

LEGEND

- ① ITEM 448 Type I ~ 1 1/2" ASPHALT CONCRETE SURFACE COURSE TO BE APPLIED 12 MONTHS AFTER ITEM 448 TYPE II
- ② ITEM 407 ~ RS-2 TACK COAT (0.10 GAL./SQ. YD.)
- ③ ITEM 448 TYPE II ~ 2" ASPHALT CONCRETE INTERMEDIATE COURSE
- ④ ITEM 301 ~ 3 1/2" ASPHALT BASE
- ⑤ ITEM 304 ~ 4" AGGREGATE BASE
- ⑥ ITEM 204 ~ SUBGRADE COMPACTION
- ⑦ ITEM 609 ~ COMBINED MOUNTABLE CONCRETE CURB AND GUTTER, TYPE "C"
- ⑧ ITEM 608 ~ 4" THICK CONCRETE WALK
- ⑨ ITEM 605 ~ FLEXIBLE N-12 6" OR 8" UNDERDRAIN, WITH GEOTEXTILE WRAP, BACKFILLED WITH #8, #9 OR #89 STONE
- ⑩ ITEM 659 ~ SEEDING AND MULCHING
- ⑪ 4" SUMP DRAIN AS NEEDED TO BE TIED INTO DOWN STREAM STORM STRUCTURE

DESIGN BY SOIL CLASSIFICATION, DRAINAGE LAYER DESIGN

	A	B	C	D
ITEM 304	4"	4"	4"	4"
ITEM 301	4"	4"	4"	4 1/4"
ITEM 448	1 3/4"	1 3/4"	1 3/4"	1 3/4"
ITEM 448	1 1/4"	1 1/4"	1 1/4"	1 1/4"